

# Blueprints

*Nocti*  
**Business Solutions**<sup>®</sup>  
Your Corporate Assessment Provider  
[www.noctibusiness.com](http://www.noctibusiness.com)

*Industrial Assessment Blueprint*

*Test Code: 0634 / Version: 01*

*Electrical Electronics Maintenance*


**Enhancing today's workforce  
through tailored performance solutions**

## Written Assessment:

Administration Time: 3 hours

Number of Questions: 150

### Areas Covered:

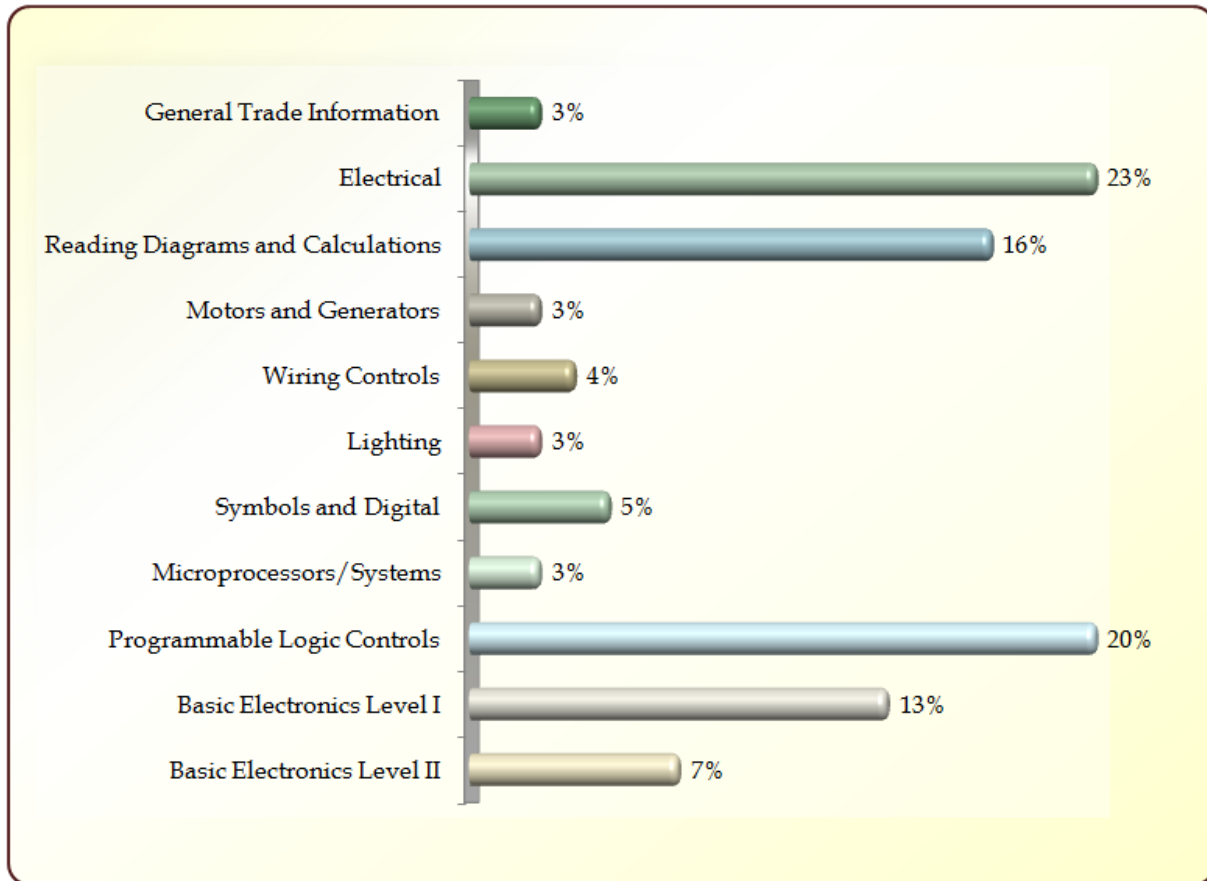

## Sample Questions:

The proper way to check for a good ground in a power tool is between

- the front and rear areas of the case
- either the hot or the neutral prong of the plug and the ground wire prong
- the hot and neutral prong of the plug
- the case and the ground wire prong

All starters are basically rated in

- ohms
- volts
- frequency
- horsepower

In order to reverse the direction of a split-phase motor, it is necessary to

- interchange the line leads
- reverse the connections to both the starting and running windings
- reverse the wires to the capacitor
- reverse the connections to the starting winding

What type of switch circuit is indicated by an OR gate?

- parallel
- series parallel
- parallel series
- series

When power is removed from a PC

- the Executive Memory is usually lost
- the User Program is often maintained by a Battery Backup system
- the ROM will usually have to be reprogrammed
- the Application Memory will usually not be affected

