

# Blueprints

*Nocti*  
**Business Solutions**<sup>®</sup>  
Your Corporate Assessment Provider  
[www.noctibusiness.com](http://www.noctibusiness.com)

*Industrial Assessment Blueprint*

*Test Code: 0650 / Version: 01*

*Instrumentation and Electrician Technician*


**Enhancing today's workforce  
through tailored performance solutions**

**Written Assessment:**

**Administration Time:** 3 hours

**Number of Questions:** 100

**Areas Covered:**

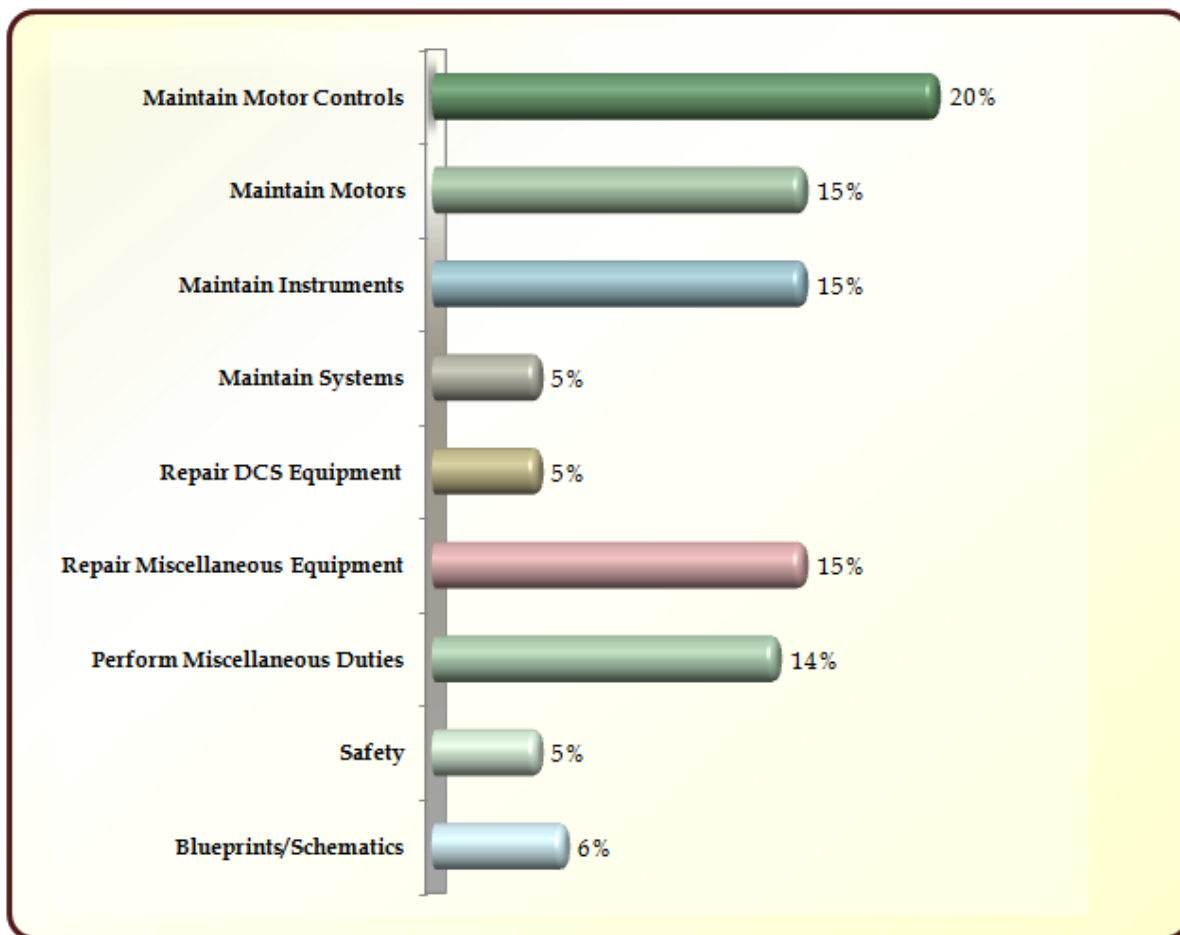

## Sample Questions:

The only safe, reliable way to lock out a motor is by

- A. tagging every operator station in the "off" position
- B. locking out the local ON-OFF switch
- C. deactivating the control circuit
- D. interrupting the circuit at the motor disconnect

Instead of using a permanent magnet to generate the stationary magnetic field, most motors use

- A. an electro-magnetic capacitor
- B. a transformer
- C. field coils
- D. a battery

Pneumatic signals can be converted to electronic signals using a

- A. ct
- B. amp meter
- C. p/i converter
- D. square root extractor

Select a device you would use to determine hydraulic pressure

- A. pressure gauge
- B. hydraulic flowmeter
- C. multimeter
- D. flowmeter

The purpose of conforming to the National Electrical Code in wiring is to

- A. provide better lighting
- B. insure a smaller light bill
- C. make your electric motors run better
- D. insure safety in your electrical system

